

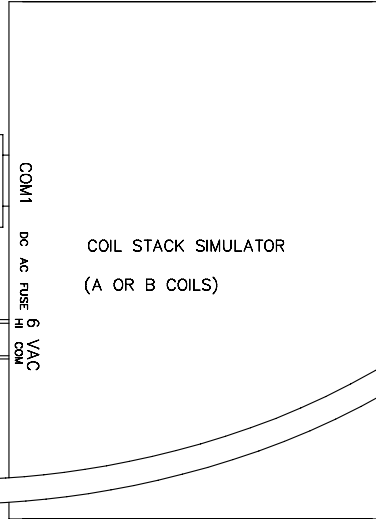


DB9 TO RJ12 ADAPTER

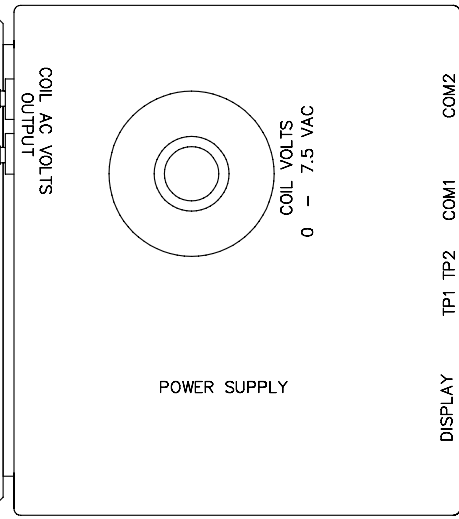

6VAC POWER CABLE

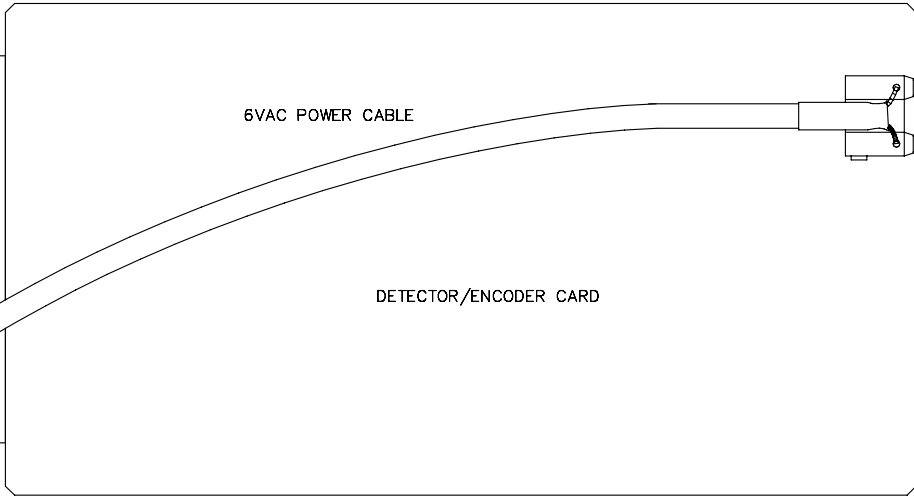


120VAC POWER CORD NOT SHOWN

TO PC
DB9 CABLE BY USER
(OPTIONAL)

DB9 TO RS12 ADAPTER

POWER SUPPLY COM1 AND COM2 ARE INTERCHANGEABLE.
PC OR CONTROL UNIT MAY BE CONNECTED TO EITHER

PS - D/E CARD - CS SIMULATOR MAY BE POSITIONED
HORIZONTALLY OR ON SIDE AS DESIRED TO
FACILITATE TROUBLESHOOTING

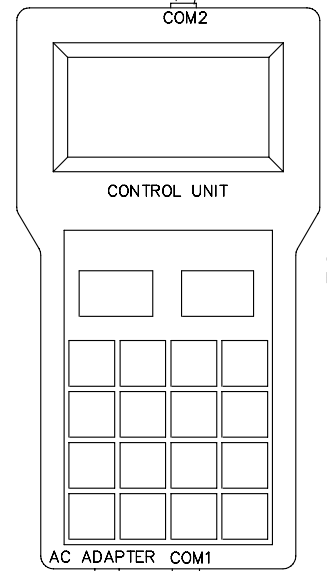

CONTROL UNIT COM1 AND COM2 ARE INTERCHANGEABLE.
POWER SUPPLY OR SIMULATOR MAY BE CONNECTED TO EITHER

RJ12-RJ12 DATA CABLE
7' or 25'

RJ12-RJ12 DATA CABLE
7' or 25'

AC ADAPTER IS NORMALLY
NOT NEEDED. CONTROL UNIT
OBTAINS POWER FROM POWER
SUPPLY OR SIMULATOR VIA
DATA CABLE

CAMP CREEK TECHNOLOGIES
DETECTOR/ENCODER CARD TESTER
BENCH TESTING
CONFIGURATION

DRAWN	GES	4/26/07	SCALE	1"=1"
APPR			FILE	200607-01
E		200607-01		REV 0

NO.	REVISION	DRWN	APPR	DATE